
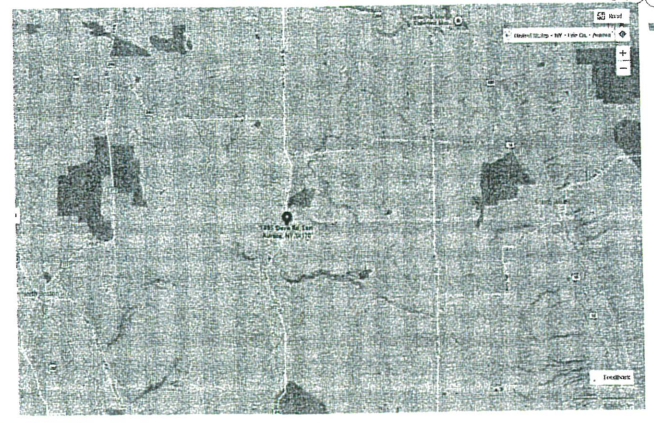


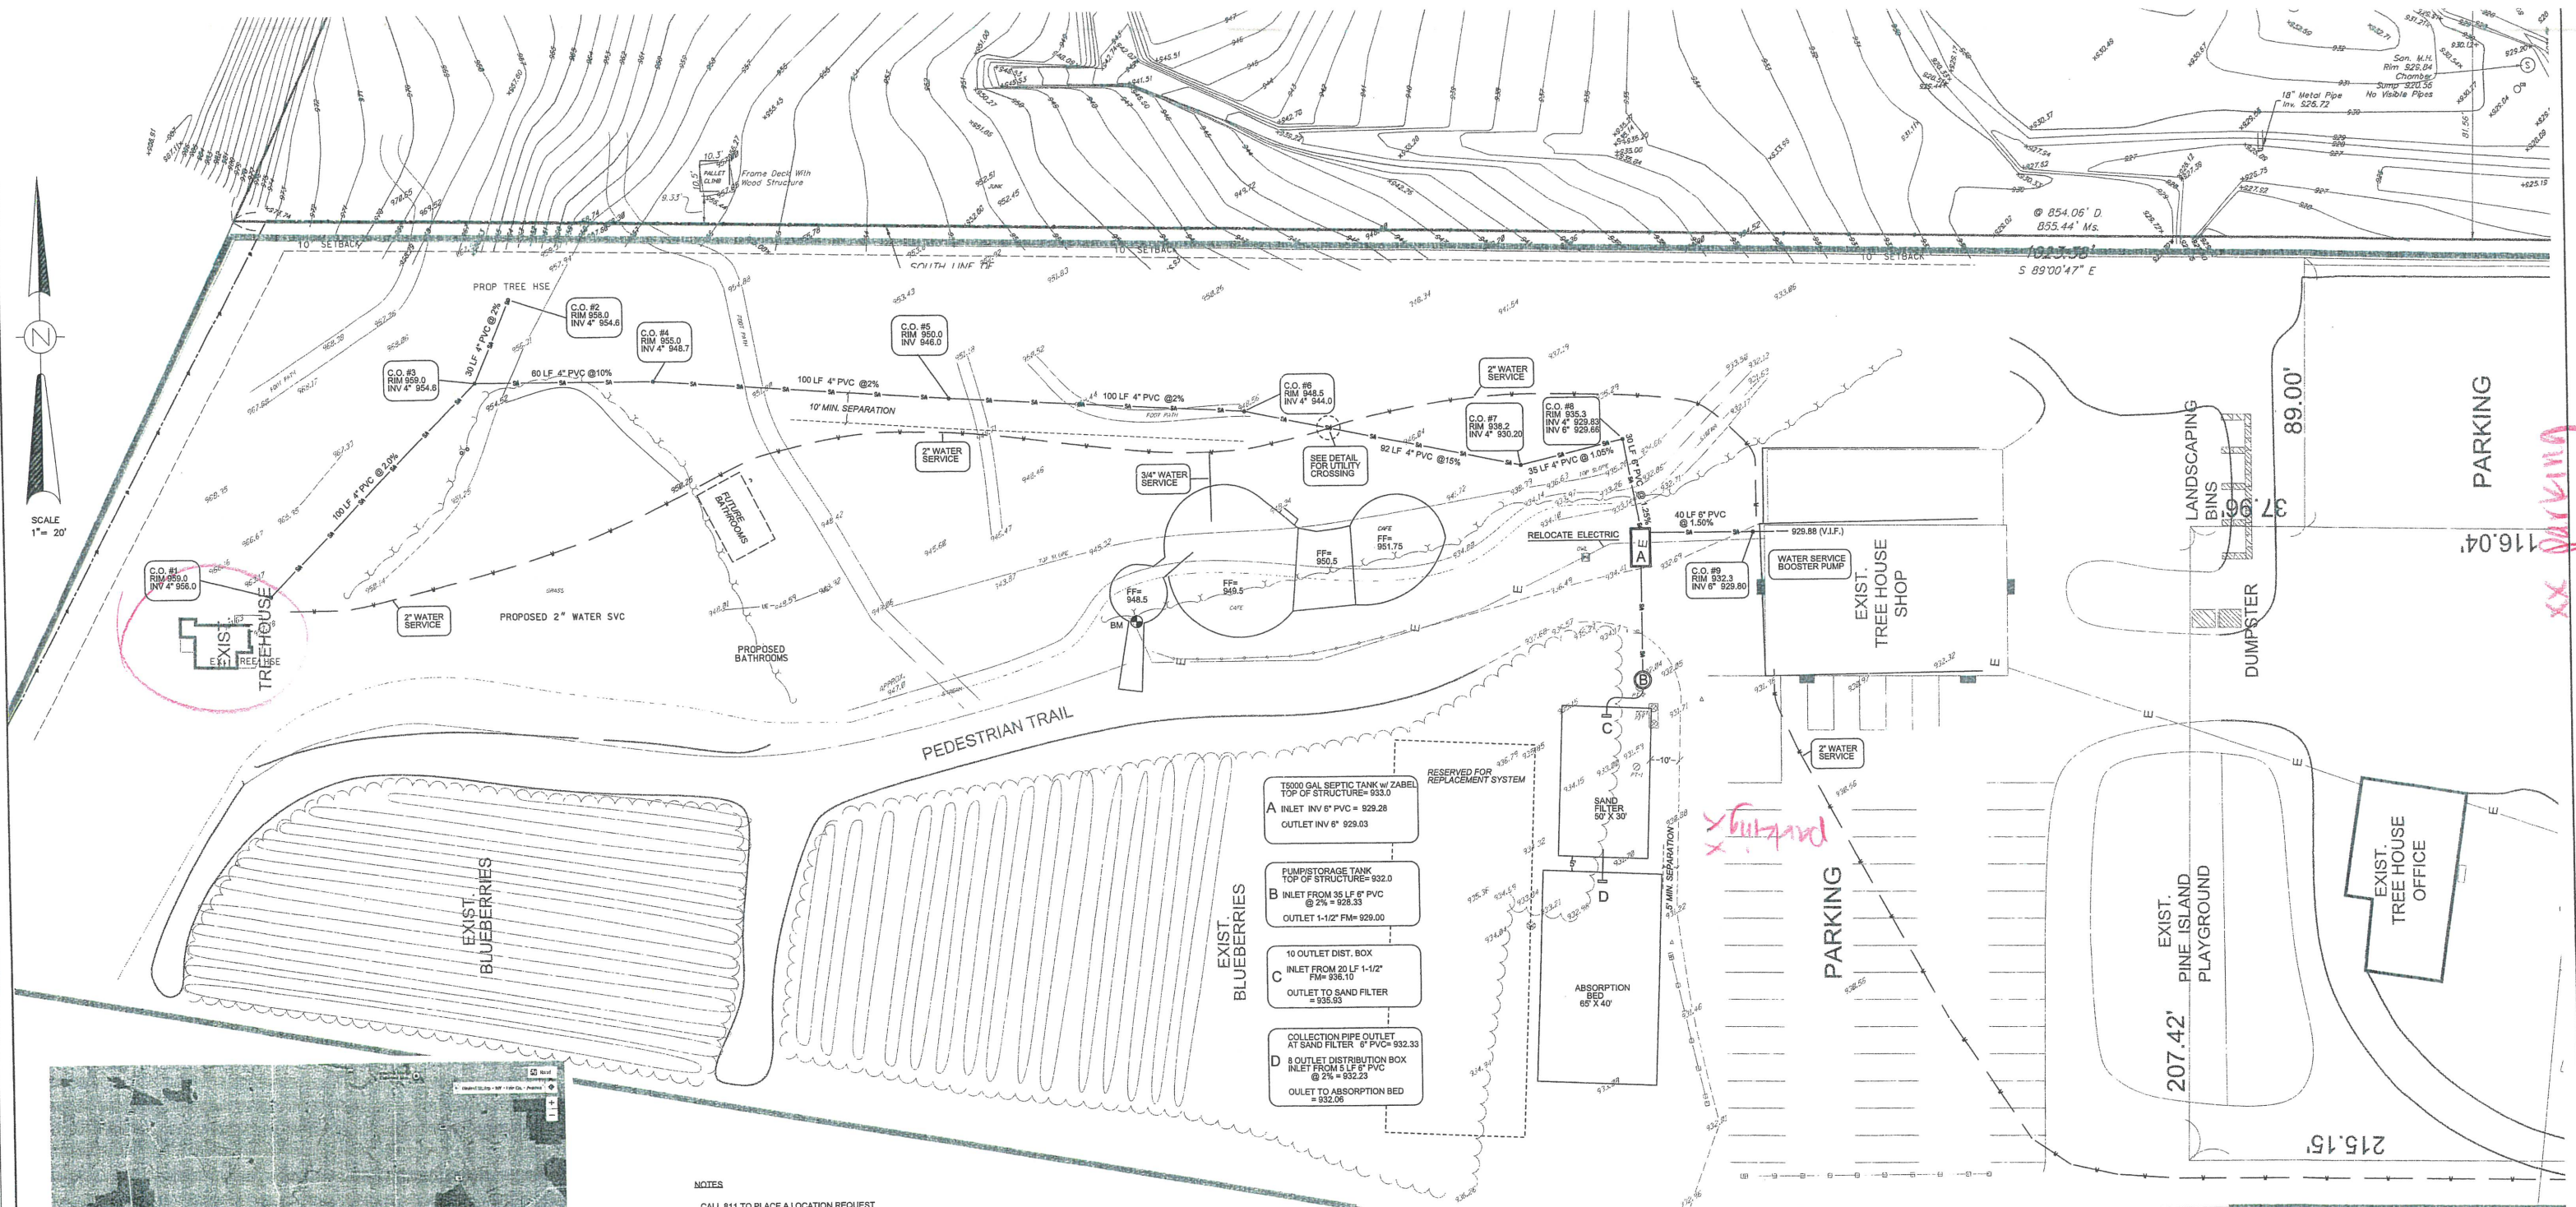

NOTES

CALL 811 TO PLACE A LOCATION REQUEST AT LEAST 2 DAYS BUT NOT MORE THAN 10 DAYS BEFORE EXCAVATION BEGINS

NOT ALL UTILITY LOCATIONS ARE KNOWN OR SHOWN. COORDINATE WITH THE OWNER AND VERIFY IN THE FIELD

WHERE SERVICE HAS LESS THAN 4' OF COVER, INSULATION OR A RAISED EARTHEN BERM SHOULD BE CONSTRUCTED

— SA — SA — PROPOSED SANITARY SEWER SERVICE
PVC 8" x 8"

— W — W — PROPOSED 2" WATER SERVICE

BM= FF AT TOP OF RAMP AT ENTRANCE TO GAZEBO
ELEVATION = 946.55

20 0 20 40 60 80

- 15,000 GAL SEPTIC TANK W/ ZABEL TOP OF STRUCTURE = 933.0
A INLET INV 6" PVC = 929.28
OUTLET INV 6" = 929.03
- PUMP/STORAGE TANK
TOP OF STRUCTURE = 932.0
B INLET FROM 35 LF 6" PVC @ 2% = 928.33
OUTLET 1-1/2" FM = 928.00
- 10 OUTLET DIST. BOX
INLET FROM 20 LF 1-1/2" FM = 936.10
C OUTLET TO SAND FILTER = 935.93
- COLLECTION PIPE OUTLET AT SAND FILTER 6" PVC = 932.33
D 8 OUTLET DISTRIBUTION BOX INLET FROM 5 LF 6" PVC @ 2% = 932.23
OUTLET TO ABSORPTION BED = 932.06

Parking

PARKING

xx Parking

BUFFALO TREEHOUSE PRIVATE SEWAGE DISPOSAL SYSTEM		DATE: FEB 06 2023
TOWN OF AURORA, ERIE COUNTY, NEW YORK		PROJ. NO: 2203-38
KING CONSULTING ENGINEERS, PC 619 EAST AVENUE LOCKPORT, NY 14094 TEL/FAX (716) 677-5464		SHEET 1 OF 3

1) Only copies marked with an embossed seal shall be considered true and valid copies.
2) Unauthorized alteration in any survey map, design, specification, plan or report is a violation of Section 7209, Provision 2, of the New York State Education Law.